



LIANG CHI INDUSTRY (THAILAND) CO., LTD.

COUNTER FLOW INDUCED DRAFT LBC TYPE COOLING TOWER SPECIFICATION

DATE :
 TOWER MODEL NO. : LBC - T - 125
 NO. OF SETS : 1

DESIGN & OPERATING CONDITIONS

WATER FLOW RATE. : 1,396 LPM.
 HOT WATER TEMP. : 37 °C
 COLD WATER TEMP : 32 °C
 AMB. WET BULB TEMP. : 28 °C
 FAN B.H.P. : 2.5 BHP
 TOWER PUMP HEAD : 3 M
 DRIFT LOSS OF WATER FLOW RATE : 0.2 %
 EVAPORATION LOSS OF WATER FLOW RATE: 0.83 %
 DESIGN WIND LOAD : 150 Kg / M²

STRUCTURAL DETAILS

OVERALL DIMENSION : 3050 MM
 DRY WEIGHT : 466 Kg
 OPERATING WEIGHT PER TOWER : 1356 Kg

CONSTRUCTION

TOWER SUPPORTER FRAME ASS'Y : F.R.P.
 CASING : F.R.P.
 CASING SUPPORTOR : H.D.G.S.
 COLD WATER BASIN : F.R.P.
 FILLING : P.V.C.
 FILLING SUPPORTOR : H.D.G.S.
 FAN GUARD : H.D.G.S.
 MECHANICAL EQUIPMENT SUPPORTOR : H.D.G.S.
 INLET LOUVER : P.V.C.
 BOLTS,NUTS & WASHERS : C.P.S.

LIANG CHI IND. (THAILAND) CO., LTD.	
TECHNIC DEPT.	
<input type="checkbox"/>	FOR REFERENCE
<input checked="" type="checkbox"/>	FOR APPROVAL
<input type="checkbox"/>	APPROVED
<input type="checkbox"/>	OTHER.....
DATE :	
TECHNIC BY :	



LIANG CHI INDUSTRY (THAILAND) CO., LTD.

COUNTER FLOW INDUCED DRAFT LBC TYPE COOLING TOWER SPECIFICATION

WATER DISTRIBUTION :
 STAND PIPE : P.V.C.
 SPRINKLER HEAD : A.A.
 MODEL : LSH - 125
 SPRINKLER PIPE : P.V.C.

LIANG CHI IND. (THAILAND) CO., LTD.
TECHNIC DEPT.
<input type="checkbox"/> FOR REFERENCE
<input checked="" type="checkbox"/> FOR APPROVAL
<input type="checkbox"/> APPROVED
<input type="checkbox"/> OTHER.....
DATE :
TECHNIC BY :

MECHANICAL EQUIPMENTS

FAN UNIT

NO. OF UNIT : 1 UNIT / SET
 TYPE : AXIAL FLOW
 MODEL : LSF-150
 MANUFACTUROR : LIANG CHI IND.CO.,LTD.
 DIAMETER : 1470 MM
 NO. OF BLADES : 4
 FAN SPEED : 700 RPM
 TIP SPEED : 53.8 M/S
 BLADE MATERIAL : A.A.
 HUP MATERIAL : A.A.
 AIR VOLUME : 830 M³ / MIN/SET

FAN MOTOR

NO. OF UNIT : 1 UNIT / SET
 TYPE : TEFC
 INSULATION : CLASS F IP55
 MANUFACTUROR : LIANG CHI
 SPEED : 700 RPM
 RATED H.P : 3 H.P * 8P
 POWER SOURCE (VOLT / PHASE / HZ) : 380 / 3 / 50



LIANG CHI INDUSTRY (THAILAND) CO., LTD.

COUNTER FLOW INDUCED DRAFT LBC TYPE COOLING TOWER SPECIFICATION

<u>PIPING CONNECTION</u>		SIZE		Q'TY / SET
WATER INLET	:	5	B (125 A)	1
WATER OUTLET	:	5	B (125 A)	1
AUTO FILL	:	1	B (25 A)	1
QUICK FILL	:	1	B (25 A)	1
OVER FLOW	:	2	B (50 A)	1
DRAIN	:	2	B (50 A)	1

REMARK

F.R.P : FIBERGLASS REINFORCE PLASTIC

H.D.G.S : HOT DIP GALVALNIZED STEEL

A.A. : ALUMINIUM ALLOY


C.P.S. : CHROMATED - PLATING STEEL

DESIGNED : 

CHECK : 

APPROVE : 


LIANG CHI IND. (THAILAND) CO., LTD.	
TECHNIC DEPT.	
<input type="checkbox"/>	FOR REFERENCE
<input checked="" type="checkbox"/>	FOR APPROVAL
<input type="checkbox"/>	APPROVED
<input type="checkbox"/>	OTHER.....
DATE :	
TECHNIC BY :	

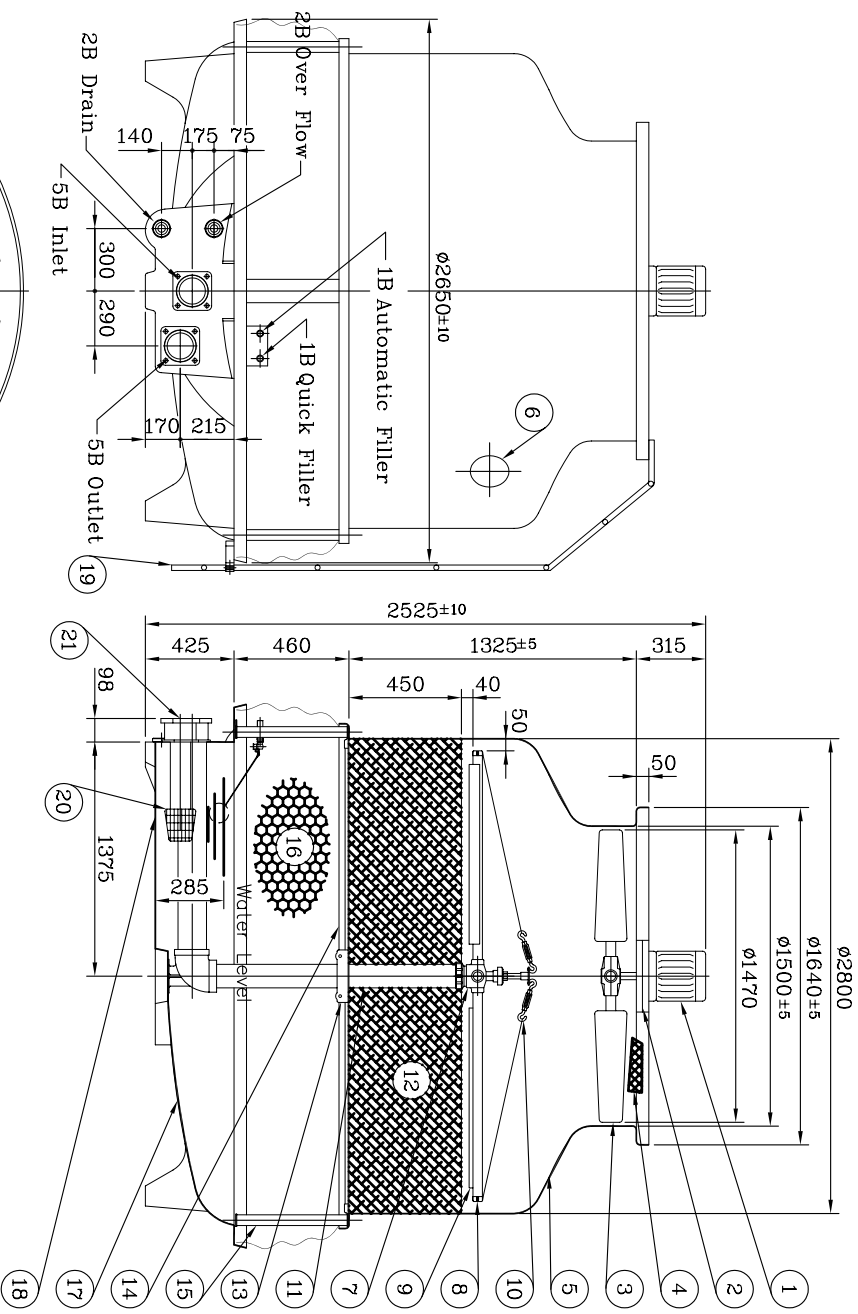

Description	M.T	Specification	Q'ty
1 Fan Motor		3HP*8P	1 PCS
2 Motor Framework Assy	H.D.G.S		1 PCS
3 Fan	A.A.	LSF-150	1 SET
4 Fan Guard	H.D.G.S.		1 SET
5 Casing	F.R.P.		6 PCS
6 Hand Hole	E.V.A.		1 PCS
7 Sprinkler Head	A.A.	LSH-125	1 PCS
8 Sprinkler Pipe	P.V.C.		4 PCS
9 Eliminator	F.R.P.		4 PCS
10 Tension Device	F.R.P.		4 SET
11 Stand Pipe	P.V.C.		1 PCS
12 Filling	P.V.C.		1 SET
13 Stopper or Column	H.D.G.S		1 SET
14 Filling Supporter	H.D.G.S		1 SET
15 Casing Supporter	H.D.G.S		6 PCS
16 Inlet Louver	P.V.C.		1 SET
17 Water Basin	F.R.P.		5 PCS
18 Water Sump	F.R.P.		1 PCS
19 Ladder	H.D.G.S		1 PCS
20 Strainer	P.E.		1 PCS
21 Flange	H.D.G.S		2 PCS

LANG CHI IND. (THAILAND) CO.,LTD
TECHNIC DEPT.




FOR REFERENCE
 FOR APPROVAL
 APPROVAL
 OTHER.....
 DATE:,
 TECHNIC BY:,

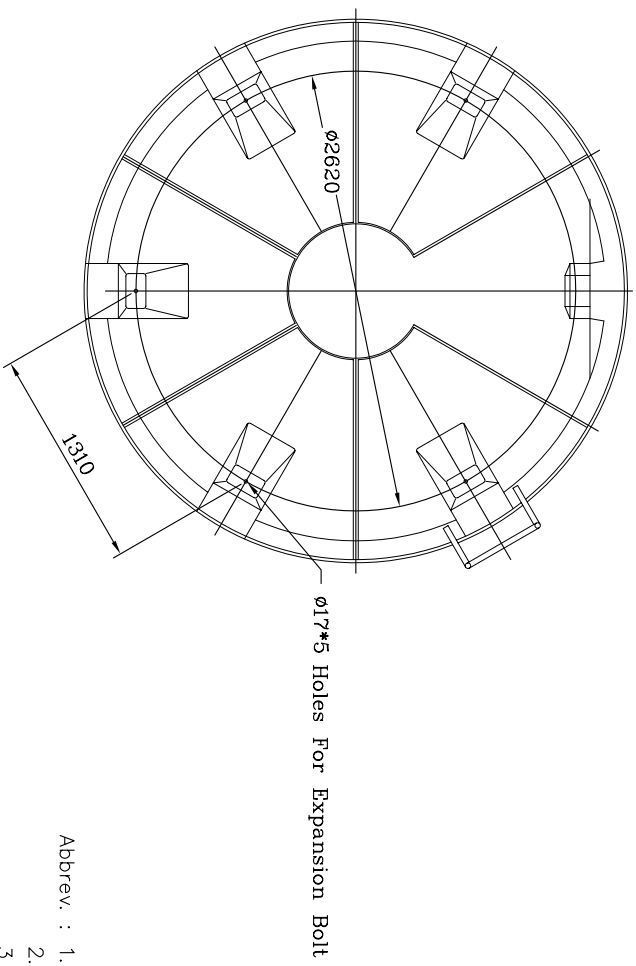

Abbrev. : 1. H.D.G.S.:Hot Dip Galvanized Steel
 2. A.A. : Aluminum Alloy
 3. S.T.S : Stainless Steel 304
 4. F.R.P. : Fiberglass Reinforced Plastic

Drain	50A (2 B)	Over Flow	50A(2 B)
Outlet	125A (5 B)	quick Filler	25A(1 B)
Inlet	125A (5 B)	Automatic filler	25A(1 B)
Pipe Connections			
Dry Weight	466 kgs	Operating Weight	1,356 kgs
Loading Data			
Ambient Wetbulb	: 28 °C	Air Volume	: 830 M ³ /MIN
Outlet Water Temp	: 32 °C	Water Flow	: 1,396 LPM
Inlet Water Temp	: 37 °C	Cooling Capacity	: 418,800 Kcal/HR
Design Condition			
REV.	DATE	DWG BY	APP.
TITLE		LBC-T-125	
OUTLINE VIEW			
APP.	K.Somons	DESIGN	Annot
CHECK	SURASAK	DWG BY.	Annot
LANG CHI INDUSTRY (THAILAND) CO., LTD.		LBC-T-125-01	
223 Moo 9 Tab-YaoLad-KRABANG BANGKOK 10520		(NUM KRAL INDUSTRIAL ZONE LUANG-PAENG RD.)	

EXPANSION BOLT (BY LIANG CHI)

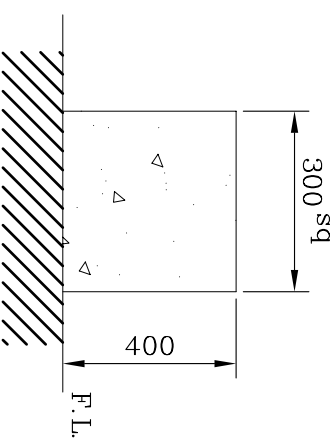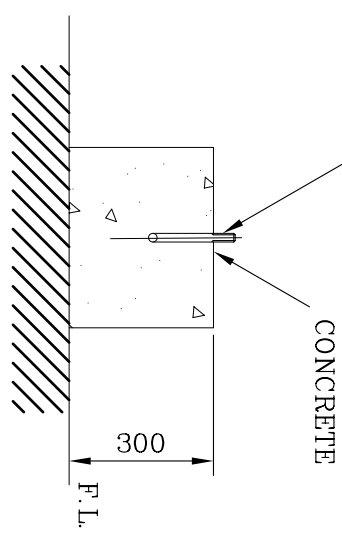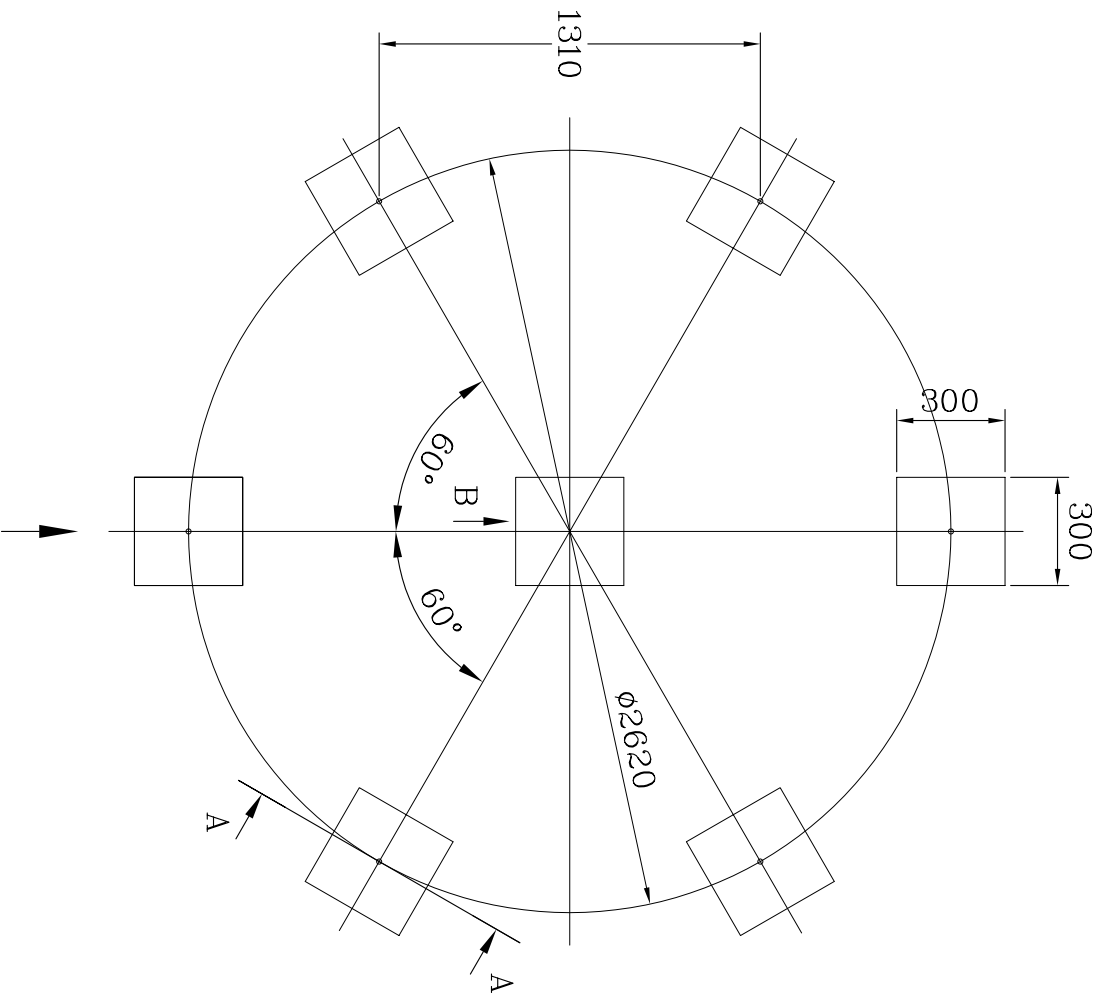

REMARK :

1. THIS FOUNDATION DRAWING IS PROVIDED FOR END USER'S REFERENCE.
2. COOLING TOWER DOES NOT INCLUDE FOUNDATION
3. THE LEVEL TOLERANCE OF FOUNDATION IS ±2 mm.
4. THE HEIGHT OF FOUNDATION EXCLUDES THERMAL ISOLATOR AND WATER PROOF.
- * 5. EXPANSION BOLT & RUBBER PAD SHALL BE FURNISHED BY LIANG CHI
(PLEASE DON'T PREPARE HOLE OF EXPANSION BOLT BEFORE INSTALLATION)

Water Inlet


LIANG CHI IND. (THAILAND) CO.,LTD
TECHNIC DEPT.

FOR REFERENCE
 FOR APPROVAL
 APPROVAL
 OTHER.....

DATE:

TECHNIC BY:

REV.	DATE	DWG BY	APP.	NOTE
LBC-T-125				
Concrete Foundation				
APP.	K.Somanas	DESIGN	Annat	
CHECK	SURASAK	DWG BY.	Annat	
LIANG CHI INDUSTRY (THAILAND) CO., LTD. 223 Moo 9 Tab-Yaolad-Krabang Bangkok 10520 (NUM KRAL INDUSTRIAL ZONE LUANG-PAENG RD.)				
				MM
				X
				DWG-NO
				LBC-T-125-02

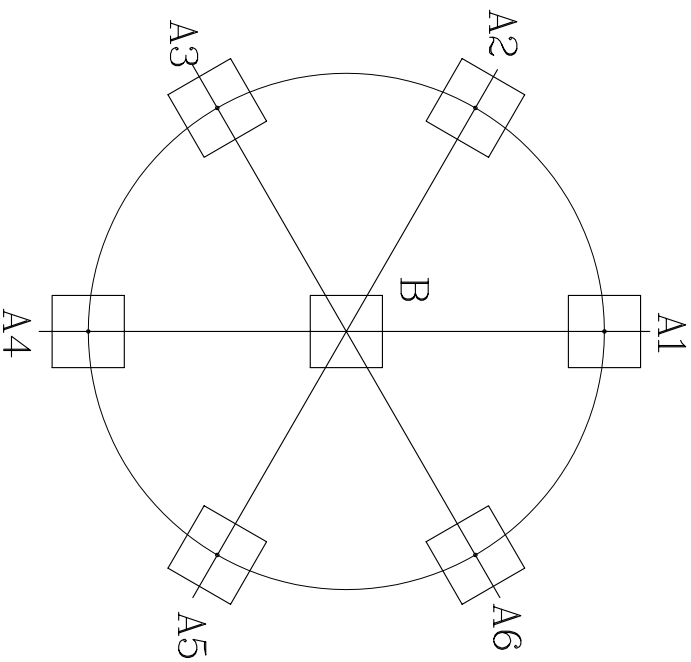

UNIT : KG.

LBC-T-125	A1 = A2 = ... = A6	B
	98	768

LIANG CHILIND (THAILAND) CO.,LTD
 TECHNIC DEPT.
 FOR REFERENCE
 FOR APPROVAL
 APPROVAL
 OTHER.....
 DATE :
 TECHNIC BY :

REV.	DATE	DWG BY	APP.	NOTE
		LBC-T-125		
TITLE				
Loading Data				
APP.	K.Somanos	DESIGN	Annat	MM
CHECK	SURASAK	DWG BY.	Annat	DWG-NO
LIANG CHI INDUSTRY (THAILAND) CO., LTD. 223 Moo 9 Tab-Yaolad-Krabang Bangkok 10520 (NUM KRAL INDUSTRIAL ZONE LUANG-PAENG RD.)				LBC-T-125-03